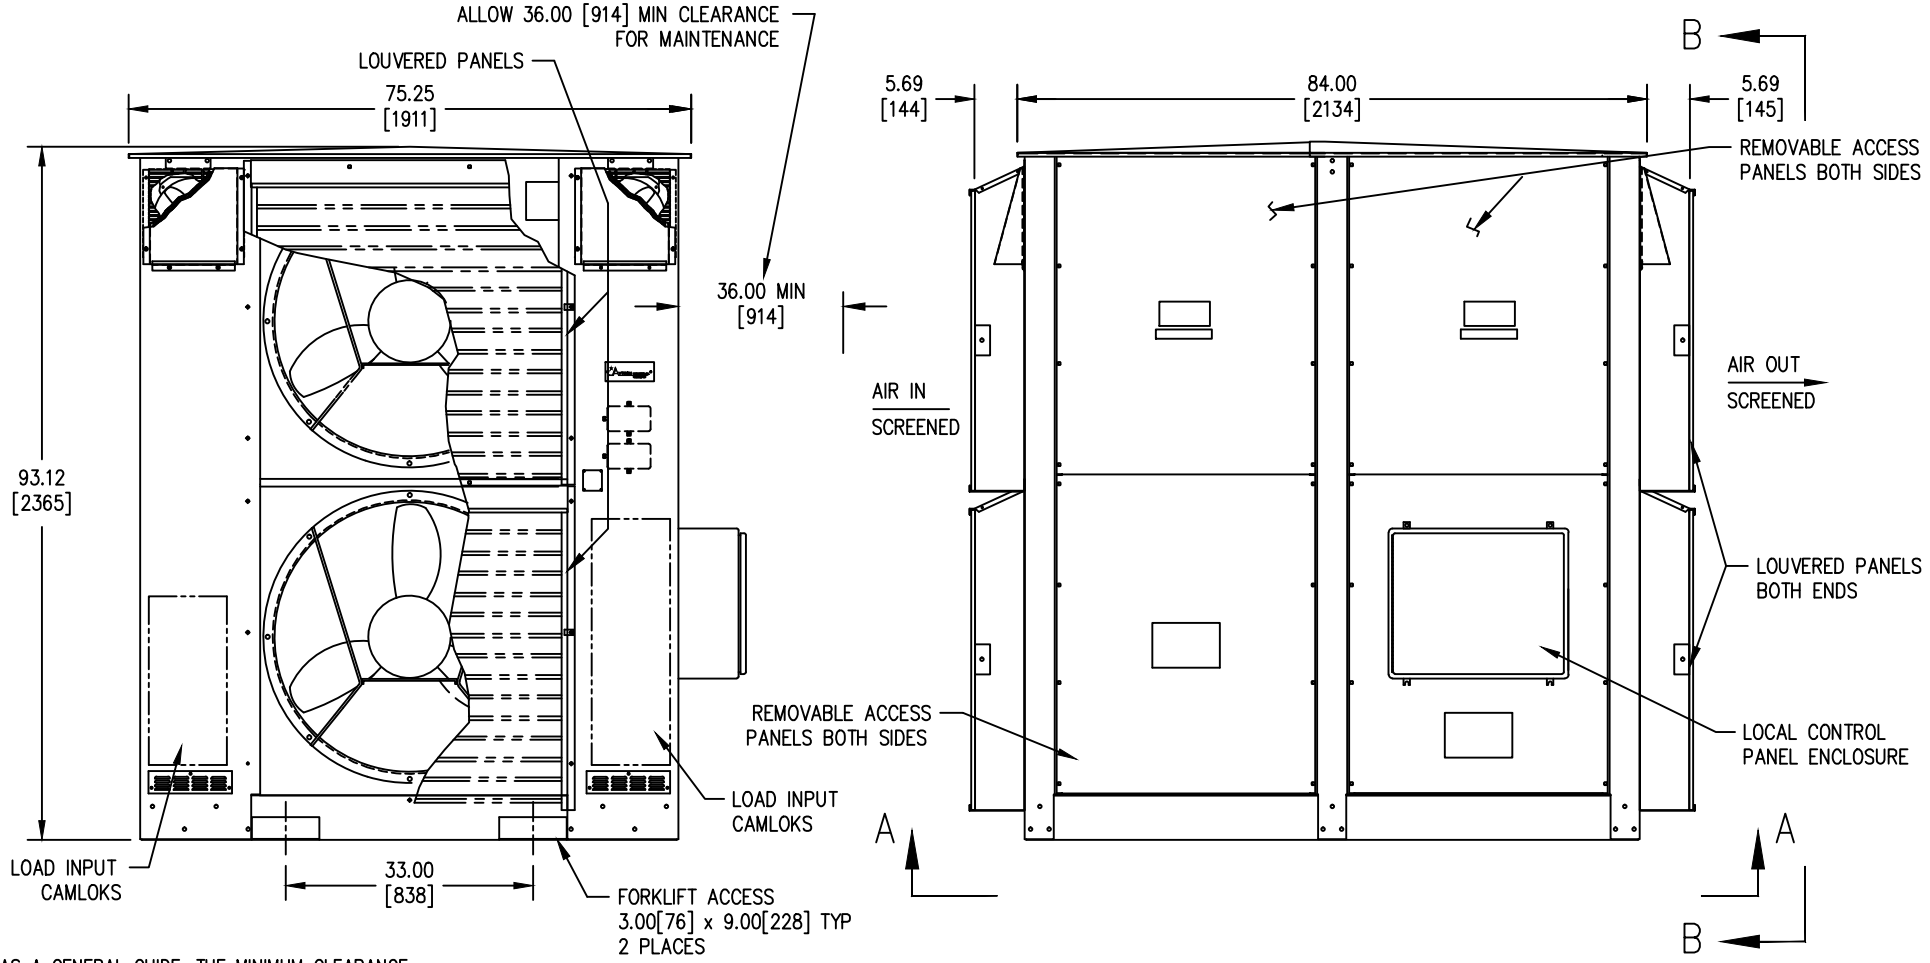

3. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS:
   6 FT [1829] ON INLET
   3 FT [914] ON SIDES
   8 FT [2438] ON EXHAUST
   REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.
2. ALL DIMENSIONS ARE APPROX. INCHES & [METRIC]
1. WEIGHT: APPROX 3600 LBS [1633] KG

NOTES:

FOR APPLICATION ENGINEERING USAGE ONLY

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AVTRON MFG., INC. AND MAY NOT BE DISCLOSED TO OTHERS OR USED FOR MANUFACTURING PURPOSES WITHOUT THE WRITTEN CONSENT OF AVTRON MFG.

ECN NO.	REV LET.	CHANGE	CHG'D	CHK'D

DRAWN	Fackelmann	DATE 12/8/06
CHECKED	J.FLAUTO	12/12/06
APPROVED	D.KOZAR	SCALE 1/16

AVTRON MANUFACTURING, INC. INDEPENDENCE, OH

LOAD BANK (OUTDOOR)

DRAWING NUMBER SB3805

SHT 1 OF 2

OUTLINE DRAWING

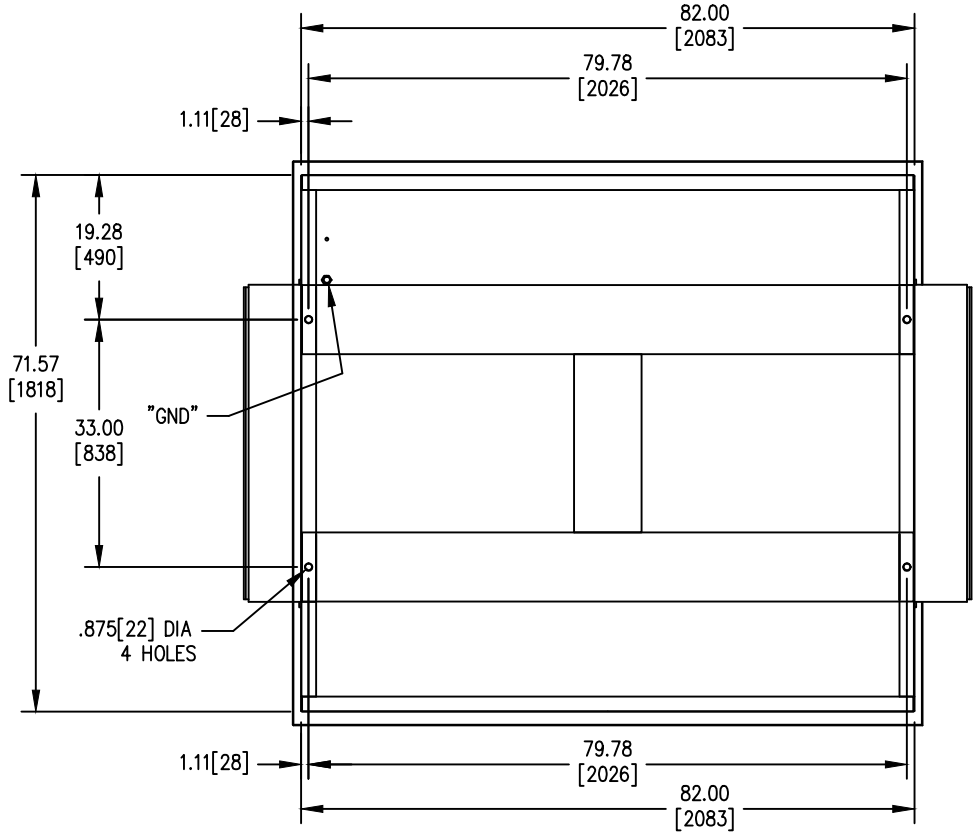

VIEW A–A

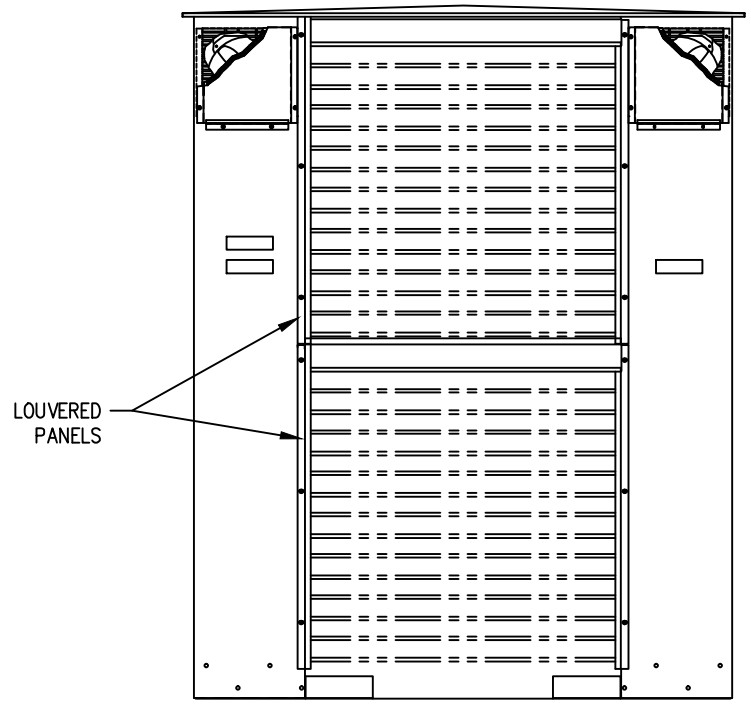

VIEW B–B

FOR APPLICATION ENGINEERING USAGE ONLY

NOTES:

ECN NO.	REV LET.	CHANGE	CHG'D	CHK'D

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AVTRON MFG., INC. AND MAY NOT BE DISCLOSED TO OTHERS OR USED FOR MANUFACTURING PURPOSES WITHOUT THE WRITTEN CONSENT OF AVTRON MFG.

AVTRON MANUFACTURING, INC.
INDEPENDENCE, OH

LOAD BANK (OUTDOOR)

DRAWING NUMBER
SB3805
SHT 2
OUTLINE DRAWING